


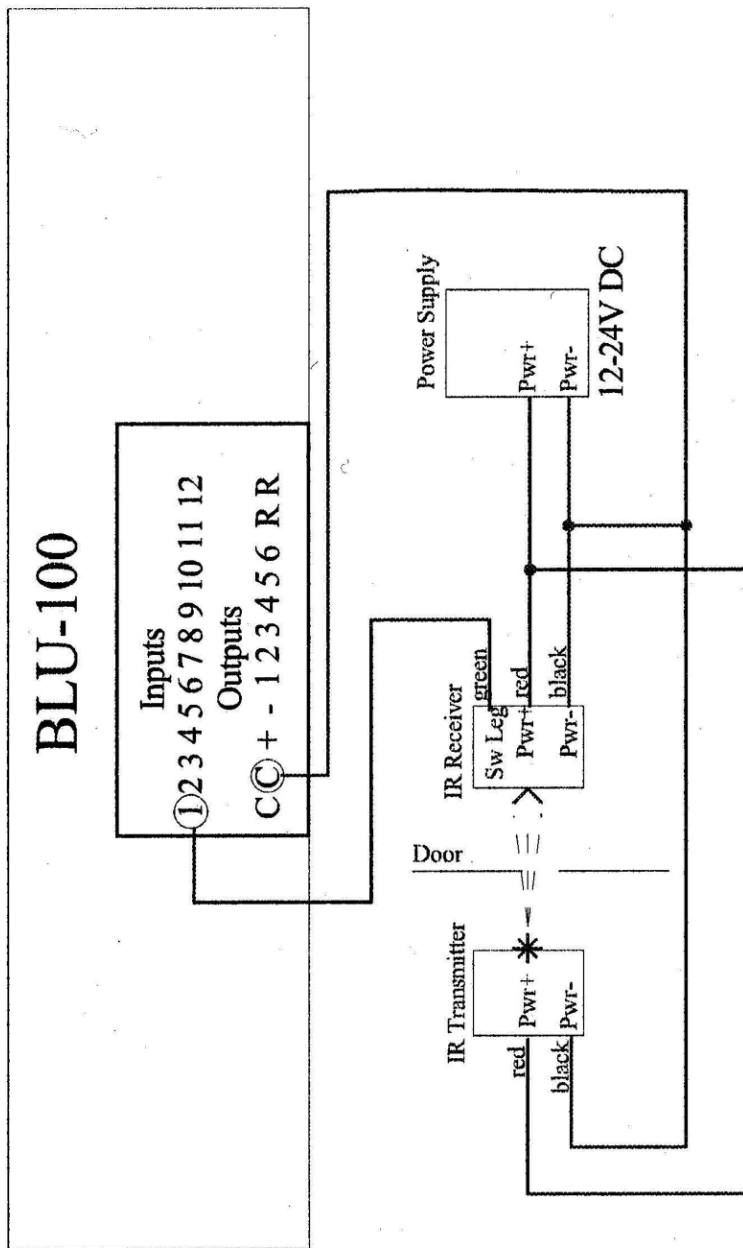

- Red wires on IR Transmitter and IR Receiver connect to Pwr+ on external power supply (+12-24V DC).
- Black wires on IR Transmitter and IR Receiver connect to Pwr- (gnd/common) of external power supply.
- Tie external power supply gnd/common (Pwr-) reference to common (C) port of London Control port.
- Switch leg from IR receiver (green wire) ties to London Control Input.